

TW-FFA Flow Amplifier.


Paddle wheel, mV ac or Vdc
frequency input amplified
to square wave voltage output.

Features.

- High Input Sensitivity.
- Compact DIN Rail Mount.
- AC mV or Vdc Frequency Input.
 - Paddle Wheel
 - Transducers
- Cost Effective.
- Easy to Install.
- Reverse Polarity Protection.



Z495

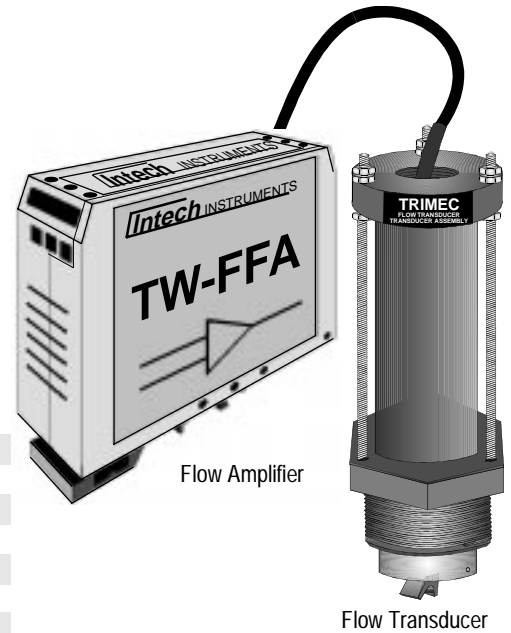

Flow Amplifier

Flow Transducer


Description.

The TW-FFA Flow Amplifier was designed and manufactured specifically for use with flow transducers (or other ac/dc waveforms) to provide a stable and amplified output for further processing. The input voltage signal from a flow transducer is amplified to a square wave output. Typical applications include flow totalisation and rate of fluids in pipe sizes ranging from 1/2" to 96" diameter.

Specifications.

Paddle Wheel or AC mV Input.	-Minimum 10mVpp. -Maximum 30Vpp.
DC Frequency Input	-Threshold 2.5Vdc -Amplitude 5 to 30Vdc Square Wave.
Output	Square wave.
-Output Frequency	Equals Input Frequency.
-No Load Amplitude	Output = 90% of Supply Voltage.
-Full load Amplitude	Output = 80% of Supply Voltage.
Maximum Frequency	10kHz.
Power Supply	5~32Vdc.
Current Usage (No load)	4mA @ 5Vdc Typical. 15mA @ 24Vdc Typical.
Maximum Output Current	20mA @ 5Vdc. 50mA @ 12Vdc. 200mA @ 24Vdc.
EMC Emissions Compliance	EN 55022-A.
EMC Immunity Compliance	EN 50082-1. $\pm 1\%$ Effect FSO Typical.
Operating Temperature	0~70C.
Storage Temperature	-20~80C.
Operating Humidity	5~85% RH Max. Non-condensing.
Dimensions	L=79, W=22.5, H=85mm.

Dimensions.

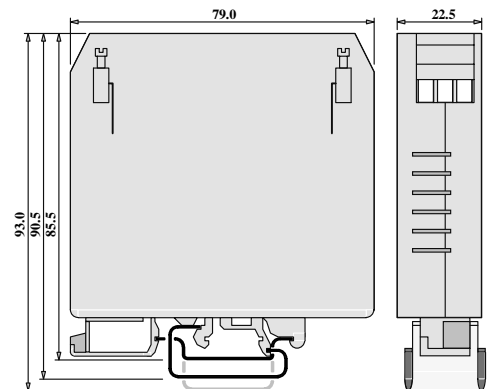


All power and signals must be de-energised before connecting any wiring, or altering any Jumpers or Dip Switches.


Product Liability. This information describes our products. It does not constitute guaranteed properties and is not intended to affirm the suitability of a product for a particular application. Due to ongoing research and development, designs, specifications, and documentation are subject to change without notification. Regrettably, omissions and exceptions cannot be completely ruled out. No liability will be accepted for errors, omissions or amendments to this specification. Technical data are always specified by their average values and are based on Standard Calibration Units at 25C, unless otherwise specified. Each product is subject to the 'Conditions of Sale'.

Warning: These products are not designed for use in, and should not be used for patient connected applications. In any critical installation an independent fail-safe back-up system must always be implemented.

Examples of Connections Diagrams.

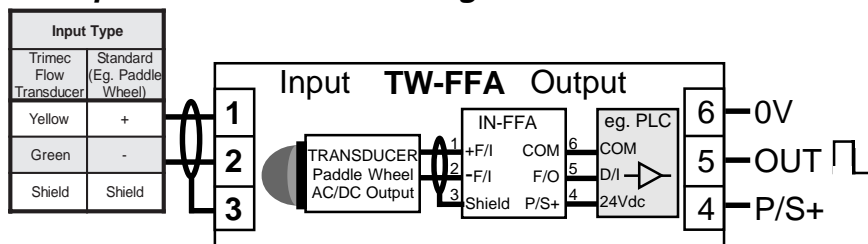

Location of Jumpers.

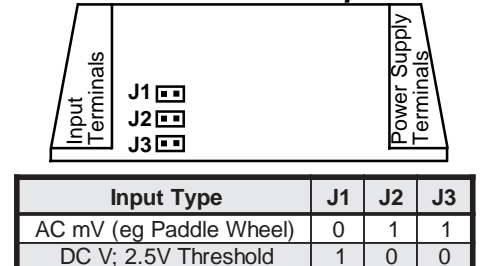

Quality Assurance Programme.

The modern technology and strict procedures of the ISO9001 Quality Assurance Programme applied during design, development, production and final inspection grant long term reliability of the instrument.

Intech INSTRUMENTS LTD
www.intech.co.nz
 Christchurch Ph: +64 3 343 0646
 Central Ph: 06 876 0034
 Auckland Ph: 09 827 1930
 Email: sales@intech.co.nz